

# EXA D6

## INSTALLATION GUIDE

### COPYRIGHT

Electrex is a trademark of Akse S.r.l. All rights reserved.

It is forbidden to duplicate, adapt, transcript this document without Akse written authorization, except when regulated accordingly by the Copyright Laws.

### WARRANTY

This product is covered by a warranty against material and manufacturing defects for a 24 months period from the manufacturing date.

The warranty does not cover the defects that are due to:

- Negligent and improper use
- Failures caused by atmospheric hazards
- Acts of vandalism
- Wear out of materials
- Firmware upgrades

Akse reserves the right, at its discretion, to repair or substitute the faulty products

The warranty is not applicable to the products that will result defective in consequence of a negligent and improper use or an operating procedure not contemplated in this manual.

### RETURN AND REPAIR FORMALITIES

Akse accepts the return of instruments for repair only when authorized in advance. The transport costs are at customer charge.

### RE-SHIPING OF REPAIRED PRODUCT

The terms for re-shipment of repaired products are ex-works, i.e. the transport costs are at customer charge.

Products returned as defective but found to be perfectly working by our laboratories, will be charged a flat fee to account for checking and testing time irrespective of the warranty terms.

### SAFETY

This instrument was manufactured and tested in compliance with IEC 61010-1 CAT III - 300V class 2 standards for operating voltages up to 300 VAC rms phase to neutral.

In order to maintain this condition and to ensure safe operation, the user must comply with the indications and markings contained in the following instructions:

- When the instrument is received, before starting its installation, check that it is intact and no damage occurred during transport.
- Before mounting, ensure that the instrument operating voltages and the mains voltage are compatible then proceed with the installation.
- The instrument power supply needs no earth connection.
- The instrument is not equipped with a power supply fuse; a suitable external protection fuse must be foreseen by the contractor.
- Maintenance and/or repair must be carried out only by qualified, authorized personnel
- If there is ever the suspicion that safe operation is no longer possible, the instrument must be taken out of service and precautions taken against its accidental use.
- Operation is no longer safe when:

- 1) There is clearly visible damaged.
- 2) The instrument no longer functions.
- 3) After lengthy storage in unfavorable conditions.
- 4) After serious damage occurred during transport

The instruments must be installed in respect of all the local regulations.

### OPERATOR SAFETY

**Warning:** Failure to observe the following instructions may lead to a serious danger of death.

- During normal operation dangerous voltages can occur on instrument terminals and on voltage and current transformers. Energized voltage and current transformers may generate lethal voltages. Follow carefully the standard safety precautions while carrying out any installation or service operation.
- The terminals of the instrument must not be accessible by the user after the installation. The user should only be allowed to access the instrument front panel where the display is located.
- Do not use the digital outputs for protection functions nor for power limitation functions. The instrument is suitable only for secondary protection functions.
- The instrument must be protected by a breaking device capable of interrupting both the power supply and the measurement terminals. It must be easily reachable by the operator and well identified as instrument cut-off device.
- The instrument and its connections must be carefully protected against short-circuit.

**Precautions:** Failure to respect the following instructions may irreversibly damage to the instrument.

- The outputs and the options operate at low voltage level; they cannot be powered by any unspecified external voltage.
- The application of currents not compatible with the current inputs levels will damage to the instrument.

Further documentation may be downloaded from our web site [www.electrex.it](http://www.electrex.it).

This document is owned by company AKSE that reserves all rights.

### DECLARATION OF CONFORMITY

Akse hereby declares that its range of products complies with the following directives EMC 89/336/EEC 73/23CE 93/68 CE and complies with the following product's standard CEI EN 61326 – IEC 61326 CEI EN 61010 – IEC 61010.

The product has been tested in the typical wiring configuration and with peripherals conforming to the EMC directive and the LV directive.

### READINGS



Keep pressed for 2 seconds to display:  
- Type of instrument  
- Firmware version  
- Serial number  
- RS485 address

### MEASURE LIST TABLE

(The parameters available vary according to instrument configuration)

| P/PF | Short keypress |           |           |          |          |
|------|----------------|-----------|-----------|----------|----------|
|      | P              | P Avg Imp | P Avg Exp | P MD Imp | P MD Exp |
|      | Q              | Q Avg Imp | Q Avg Exp | Q MD Imp | Q MD Exp |
|      | S              | S Avg Imp | S Avg Exp | S MD Imp | S MD Exp |
|      | PF             |           |           |          |          |

| U | Short keypress |           |           |           |  |
|---|----------------|-----------|-----------|-----------|--|
|   | U L-N / f      | U THD L-N | U L-N Min | U L-N Max |  |
|   | U L-L / f      | U THD L-L | U L-L Min | U L-L Max |  |

| I | Short keypress |   |       |       |       |
|---|----------------|---|-------|-------|-------|
|   | In             | I | I THD | I Max | I AVG |

| CNT | Short keypress      |              |                     |              |                          |
|-----|---------------------|--------------|---------------------|--------------|--------------------------|
|     | Ea Imp $\Sigma$     | Ea Imp P     | Ea Exp $\Sigma$     | Ea Exp P     | Ea Imp $\Sigma$ Fase     |
|     | Er Ind Imp $\Sigma$ | Er Ind Imp P | Er Ind Exp $\Sigma$ | Er Ind Exp P | Er Ind Imp $\Sigma$ Fase |
|     | Er Cap Imp $\Sigma$ | Er Cap Imp P | Er Cap Exp $\Sigma$ | Er Cap Exp P |                          |
|     | Es Imp $\Sigma$     | Es Imp P     | Es Exp $\Sigma$     | Es Exp P     |                          |
|     | C1 Pulse $\Sigma$   | C1 Pulse P   |                     |              |                          |

### LEGEND OF PARAMETERS AND SYMBOLS

|              |                                      |    |                 |
|--------------|--------------------------------------|----|-----------------|
| L-N          | Phase Neutral                        | U  | Voltage         |
| L-L          | Phase Phase                          | I  | Current         |
| THD          | Total Harmonic Distortion            | In | Neutral current |
| Avg          | Average (rolling) value              | P  | Active Power    |
| MD           | Maximum Demand                       | Q  | Reactive Power  |
| Imp          | Import value                         | S  | Apparent Power  |
| Exp          | Export value                         | PF | Power Factor    |
| Ind          | Inductive                            | Ea | Active Energy   |
| Cap          | Capacitive                           | Er | Reactive Energy |
| Min          | Minimum values (10 cycles time base) | Es | Apparent Energy |
| Max          | Maximum values (10 cycles time base) | f  | Frequency       |
| CNT $\Sigma$ | Pulse count (total)                  |    |                 |
| CNT P        | Pulse count (partial)                |    |                 |

| MECHANICAL CHARACTERISTICS |   |
|----------------------------|---|
| Case                       | Self-extinguishing plastic material class V0                                |
| Protection degree          | IP40 on front panel, IP20 terminals side                                    |
| Size                       | 105 x 90 x 58 mm (6 DIN modules)  |
| CURRENT INPUT              |   |
| Direct insertion           | Up to 300 Vrms phase-neutral or 520 Vrms phase to phase                     |
| With external VT:          | Primary: programmable (max. 400 kV)<br>Secondary: programmable (max. 300 V) |
|                            | Overload: 900 Vrms phase to phase for 1 sec                                 |
| Aux. power supply          | 230/240Vac +/- 10% 50/60Hz  |
| Self consumption:          | < 2,5VA   |
| MODELS                     |   |
| PFAE611-02                 | EXA D6 RS485 230-240V ENERGY ANALYZER                                       |
| PFAE611-12                 | EXA D6 RS485 230-240V 1DI 2DO ENERGY ANALYZER                               |

| DEVICE SETUP        |                                       |   |
|---------------------|---------------------------------------|---|
| DESCRIPTION OF KEYS |                                       |   |
|                     | Short keypress                        | Long keypress                                   |
|                     | Confirm parameter                     | Enter/Exit from the device's configuration menu |
|                     | Modify parameter                      |   |
|                     | Modify parameter                      |   |
|                     | Go to previous value                  | Go to previous page                             |
|                     | Go to next value                      | Go to next page                                 |
|                     | Exit without saving the configuration |   |

SETUP SEQUENCE

| PAGE   | MENU VOICE         | AVAILABLE PARAMETERS                                     | DEFAULT   |
|--|--------------------|--|-----------|
| PASSWORD REQUEST   |                    | 0000 ... 9999  | 0000      |
| RS485  |                    |  |           |
|  | RS485 Address      | 1 ... 247  | 27        |
|  | Rate               | 2400, 4800, 9600, 19200, 38400                           | 38400     |
|  | Data Bit           | 7 o 8  | 8         |
|  | Parity             | N = no parity, E = even, O = odd                         | N         |
|  | Stop Bit           | 1 o 2  | 2         |
|  | Silent Time (S.T.) | 0...1000 (ms)  | 100       |
| RS-485<br>ADDR 027<br>COM 38400-8-N-2<br>S.T. 100                  |                    |  |           |
| NETWORK (note n.1)   |                    |  |           |
|  | Type               | 3PH-4W, 2PH-2W, 1PH-2W, 3PH-4W-BAL, 3PH-3W-2CT           | 3PH-4W    |
|  | Export             | NO, YES  | NO        |
|  | CT                 | 1...10000 / 1 o 5  | 5/5       |
|  | VT                 | 1...400000 / 1...300                                     | 1/1       |
| NETWORK<br>TYPE 3PH-4W<br>EXPORT NO<br>CT 00005/5<br>VT 000001/001 |                    |  |           |
| AVG-MD TIME (note n.2)   |                    |  |           |
|  | POWERS             | 1...60 (minutes)   | 15        |
|  | CURRENTS           | 1...60 (minutes)   | 8         |
| AVG-MD TIME<br>POWERS 15<br>CURRENTS 08                            |                    |  |           |
| ALARM 1 / A (note n.11)  |                    |  |           |
|  | MODE (note n.3)    | Normale, 1-OF-3, 3-OF-3, DERIV, UNBAL, UNBAL%            | NORMAL    |
|  | TYPE (note n.4)    | MAX, MIN   | MIN       |
|  | MEAS (note n.5)    | Controlled measure. See table n.1 for register selection | 276       |
|  | THRE (note n.5)    | Threshold value  | +000.00   |
| ALARM 1/A<br>MODE NORMAL<br>TYPE MIN<br>MEAS 200<br>THRE 000.00    |                    |  |           |
| ALARM 1 / B  |                    |  |           |
|  | HYST               | 1...100 (%)  | 01        |
|  | DELAY              | 1...99 (seconds) ON/OFF                                  | 01 S/01 S |
|  | AVG (note n.6)     | 1...99 (seconds)   | 01        |
|  | OUT (note n.7)     | Normal, Hold, Pulse-L, Pulse-S                           | NORMAL    |
| ALARM 1/B<br>HYST 01<br>DELAY 01 S/01 S<br>AVG 01<br>OUT NORMAL    |                    |  |           |
| ALARM 2 / A (note n.11)  |                    |  |           |
|  | MODE (note n.3)    | Normale, 1-OF-3, 3-OF-3, DERIV, UNBAL, UNBAL%            | NORMAL    |
|  | TYPE (note n.4)    | MAX, MIN   | MIN       |
|  | MEAS (note n.5)    | Controlled measure. See table n.1 for register selection | 276       |
|  | THRE (note n.5)    | Threshold value  | +000.00   |
| ALARM 2 / B  |                    |  |           |
|  | HYST               | 1...100 (%)  | 01        |
|  | DELAY              | 1...99 (seconds) ON/OFF                                  | 01 S/01 S |
|  | AVG (note n.6)     | 1...99 (seconds)   | 01        |
|  | OUT (note n.7)     | Normal, Hold, Pulse-L, Pulse-S                           | NORMAL    |
| ALARM 3 / A (note n.11)  |                    |  |           |
|  | MODE (note n.3)    | Normale, 1-OF-3, 3-OF-3, DERIV, UNBAL, UNBAL%            | NORMAL    |
|  | TYPE (note n.4)    | MAX, MIN   | MIN       |
|  | MEAS (note n.5)    | Controlled measure. See table n.1 for register selection | 276       |
|  | THRE (note n.5)    | Threshold value  | +000.00   |
| ALARM 3 / B  |                    |  |           |
|  | HYST               | 1...100 (%)  | 01        |
|  | DELAY              | 1...99 (seconds) ON/OFF                                  | 01 S/01 S |
|  | AVG (note n.6)     | 1...99 (seconds)   | 01        |
|  | OUT (note n.7)     | Normal, Hold, Pulse-L, Pulse-S                           | NORMAL    |
| ALARM 4 / A (note n.11)  |                    |  |           |
|  | MODE (note n.3)    | Normale, 1-OF-3, 3-OF-3, DERIV, UNBAL, UNBAL%            | NORMAL    |
|  | TYPE (note n.4)    | MAX, MIN   | MIN       |
|  | MEAS (note n.5)    | Controlled measure. See table n.1 for register selection | 276       |
|  | THRE (note n.5)    | Threshold value  | +000.00   |

|  |                     |  |           |
|--|---------------------|--|-----------|
| ALARM 4 / B  |                     |  |           |
|  | HYST                | 1...100 (%)  | 01        |
|  | DELAY               | 1...99 (seconds) ON/OFF                                      | 01 S/01 S |
|  | AVG (note n.6)      | 1...99 (seconds)   | 01        |
|  | OUT (note n.7)      | Normal, Hold, Pulse-L, Pulse-S                               | NORMAL    |
| DIGITAL OUT 1 (note n.8)   |                     |  |           |
|  | MODE                | PULSE, ALARM, REMOTE   | PULSE     |
|  | POLARITY            | NO, NC   | NO        |
| DIGITAL OUT 1<br>MODE PULSE<br>POLATITY NO                               |                     |  |           |
| DIGITAL OUT 2 (note n.8)   |                     |  |           |
|  | MODE                | PULSE, ALARM, REMOTE   | PULSE     |
|  | POLARITY            | NO, NC   | NO        |
| PULSE OUT 1  |                     |  |           |
|  | MEAS (note n.9)     | P-IMP, QL-IMP, QC-IMP, S-IMP<br>P-EXP, QL-EXP, QC-EXP, S-EXP | P-IMP     |
|  | PRIMARY (note n.10) | YES, NO  | YES       |
|  | WEIGHT              | +0.1...+100.00K (wh)   | +1000.0   |
|  | WIDTH               | 10...1000 (ms)   | 100       |
| PULSE OUT 1<br>MEAS P-IMP<br>PRIMARY YES<br>WEIGHT 100.00k<br>WIDTH 0500 |                     |  |           |
| PULSE OUT 2  |                     |  |           |
|  | MEAS (note n.9)     | P-IMP, QL-IMP, QC-IMP, S-IMP, P-EXP, QL-EXP, QC-EXP, S-EXP   | QL-IMP    |
|  | PRIMARY (note n.10) | YES, NO  | YES       |
|  | WEIGHT              | +0.1...+100.00K (wh)   | +1000.0   |
|  | WIDTH               | 10...1000 (ms)   | 100       |
| DISPLAY  |                     |  |           |
|  | CONTRAST            | 20 - 45  | 27        |
| CLEAR REGISTERS  |                     |  |           |
|  | TOTAL CNT           | NO, YES  | NO        |
|  | PARTIAL CNT         | NO, YES  | NO        |
|  | MIN-MAX             | NO, YES  | NO        |
|  | MAX DEMAND          | NO, YES  | NO        |
| RESTORE FACTORY SETTINGS   |                     |  |           |
|  | ENTER NEW PASSWORD  | 0000 ... 9999  | 0000      |

TABLE n.1 (ModBus Registers for alarm configuration)

| REGISTER | DESCRIPTION   | SYMBOL       | UNITS |
|----------|---|--------------|-------|
| 200      | Phase to Neutral Voltage, THD                                     | THD U1N      | [%]   |
| 202      | Phase to Neutral Voltage, THD                                     | THD U2N      | [%]   |
| 204      | Phase to Neutral Voltage, THD                                     | THD U3N      | [%]   |
| 206      | Phase to Phase Voltage, THD                                       | THD U12      | [%]   |
| 208      | Phase to Phase Voltage, THD                                       | THD U23      | [%]   |
| 210      | Phase to Phase Voltage, THD                                       | THD U31      | [%]   |
| 212      | Phase Current, THD  | THD I1       | [%]   |
| 214      | Phase Current, THD  | THD I2       | [%]   |
| 216      | Phase Current, THD  | THD I3       | [%]   |
| 218      | Frequency of U1N  | f            | [Hz]  |
| 220      | Phase to Neutral Voltage, RMS Amplitude                           | U1N          | [V]   |
| 222      | Phase to Neutral Voltage, RMS Amplitude                           | U2N          | [V]   |
| 224      | Phase to Neutral Voltage, RMS Amplitude                           | U3N          | [V]   |
| 226      | Phase to Phase Voltage, RMS Amplitude                             | U12          | [V]   |
| 228      | Phase to Phase Voltage, RMS Amplitude                             | U23          | [V]   |
| 230      | Phase to Phase Voltage, RMS Amplitude                             | U31          | [V]   |
| 232      | Phase Current, RMS Amplitude                                      | I1           | [A]   |
| 234      | Phase Current, RMS Amplitude                                      | I2           | [A]   |
| 236      | Phase Current, RMS Amplitude                                      | I3           | [A]   |
| 238      | Neutral Current, RMS Amplitude                                    | IN           | [A]   |
| 240      | Phase Active Power ( Imp/ Exp)                                    | P1           | [W]   |
| 242      | Phase Active Power ( Imp/ Exp)                                    | P2           | [W]   |
| 244      | Phase Active Power ( Imp/ Exp)                                    | P3           | [W]   |
| 246      | Phase Reactive Power ( Imp/ Exp)                                  | Q1           | [var] |
| 248      | Phase Reactive Power ( Imp/ Exp)                                  | Q2           | [var] |
| 250      | Phase Reactive Power ( Imp/ Exp)                                  | Q3           | [var] |
| 252      | Phase Apparent Power  | S1           | [VA]  |
| 254      | Phase Apparent Power  | S2           | [VA]  |
| 256      | Phase Apparent Power  | S3           | [VA]  |
| 258      | Phase Power Factor ( Imp/ Exp)                                    | PF1          | [-]   |
| 260      | Phase Power Factor ( Imp/ Exp)                                    | PF2          | [-]   |
| 262      | Phase Power Factor ( Imp/ Exp)                                    | PF3          | [-]   |
| 264      | Phase to Neutral Voltage, Mean THD                                | THD UI       | [%]   |
| 266      | Phase to Phase Voltage, Mean THD                                  | THD UD       | [%]   |
| 268      | Phase Current, Mean THD   | THD I        | [%]   |
| 270      | Phase to Neutral Voltage, Mean RMS Amplitude                      | UI           | [V]   |
| 272      | Phase to Phase Voltage, Mean RMS Amplitude                        | UD           | [V]   |
| 274      | Three phase current, RMS Amplitude                                | I            | [A]   |
| 276      | Total active power ( Imp/ Exp)                                    | PS           | [W]   |
| 278      | Total reactive power ( Imp/ Exp)                                  | QS           | [var] |
| 280      | Total apparent power  | SS           | [VA]  |
| 282      | Total power factor ( Imp/ Exp)                                    | PFS          | [-]   |
| 332      | Phase Current, RMS Amplitude, AVG                                 | I1 AVG       | [A]   |
| 334      | Phase Current, RMS Amplitude, AVG                                 | I2 AVG       | [A]   |
| 336      | Phase Current, RMS Amplitude, AVG                                 | I3 AVG       | [A]   |
| 344      | Total imported active power, AVG                                  | P Imp AVG    | [W]   |
| 346      | Total imported inductive power, AVG                               | Qind Imp AVG | [var] |
| 348      | Total imported capacitive power, AVG                              | Qcap Imp AVG | [var] |
| 350      | Total imported apparent power, AVG                                | S Imp AVG    | [VA]  |
| 352      | Total exported active power, AVG                                  | P Exp AVG    | [W]   |
| 354      | Total exported inductive power, AVG                               | Qind Exp AVG | [var] |
| 356      | Total exported capacitive power, AVG                              | Qcap Exp AVG | [var] |
| 358      | Total exported apparent power, AVG                                | S Exp AVG    | [VA]  |
| 376      | External Pulse Counter, With Weight, Total counter or Tariff T1   | CNT1 S       |       |
| 384      | External Pulse Counter, With Weight, Partial Counter or Tariff T2 | CNT1 P       |       |

| NOTE n.1 |   |                                 |
|----------|---|---------------------------------|
| TYPE     | 3PH-4W  | 3 phases 4 wires, Star          |
|          | 2PH-2W  | 2 phases 2 wires, biphasé       |
|          | 1PH-2W  | 1 phase 2 wires, monophasé      |
|          | 3PH-4W-BAL  | 3 phases 4 wires, Star Balanced |
|          | 3PH-3W-2CT  | 2 phases 3 wires, triangle      |
| CT       | Primary / Secondary of the current transformer (CT) |                                 |
| VT       | Primary / Secondary of the voltage transformer (VT) |                                 |

| NOTE n.2 |  |
|----------|--|
| POWERS   | Integration time of the average value (AVG) and peak value (MD) for power (from 1 to 60 minutes)   |
| CURRENTS | Integration time of the average value (AVG) and peak value (MD) for current (from 1 to 60 minutes) |

|                 |  |
|-----------------|--|
| <b>NOTE n.3</b> |  |
| NORMALE         | Classic Alarm with reference to a fixed threshold or to maximum and minimum delay and applicable hysteresis. "AVG" parameter is not used.  |
| 1-OF-3          | Consider also the 2 following registers of the selected one in "MEAS". Works on a fixed max or min threshold with delay and applicable hysteresis. If one of the three register exceed the threshold the alarm goes on. "AVG" parameter is not used. |

|        |  |
|--------|--|
| 3-OF-3 | <p>Consider also the 2 following registers of the selected one in "MEAS"<br/>         Works on a fixed max or min threshold with delay and applicable hysteresis.<br/>         When all the three register exceed the threshold the alarm goes on. "AVG"<br/>         parameter is not used.</p> |
|--------|--|

|       |  |
|-------|--|
| DERIV | <p>"THRE" parameter becomes a % value. "AVG" parameter is used. The instant value applied to the alarm on "MEAS" is compared with its value mediated obtained on the basis of the time set on "AVG". When the instantaneous value combined alarm differs in more (setting "Max") or less (setting "MIN") from the average value ("AVG %") of the percentage set on "THRE" the alarm goes on. With delay and applicable hysteresis.</p> |
|-------|--|

|       |  |
|-------|--|
| UNBAL | Consider also the 2 following registers of the selected one in "MEAS".<br>"THRE" parameter becomes a % value. Alarm goes on when one of the three register is different from the percentage set on "THRE" comply with the higher value of the three read register if "MAX" is set on "TYPE", or comply with the lower value of the three register if "MIN" is set on "TYPE"<br>With delay and applicable hysteresis. |
|-------|--|

| NOTE n.4 |  |
|----------|--|
| MAX      | Alarm setting in excess compared with the established conditions.<br>With the exception of "UNBAL".  |
| MIN      | Alarm setting in decrease compared with the established conditions.<br>With the exception of "UNBAL" |

| NOTE n.5 |  |
|----------|--|
| MEAS     | Indicates which register (and thus measure) the alarm is related.<br>See table n.1 input register.                                   |
| THRE     | Alarm threshold in absolute value, with the exception made for "DERIV" and "UNBAL" in which the value inserted becomes a percentage. |

| NOTE n.6 |   |
|----------|---|
| AVG      | Parameter to be used only in "DERIV" mode. Is the duration of the reference (in seconds) used to create a reference value for the instantaneous readings. |

| NOTE n.7 |  |
|----------|--|
| NORMAL   | Physical output of the alarm excited during the duration of the alarm. It restores automatically |
| HOLD     | Output remains excited until manual reset made via Modbus  |
| PULSE-L  | Output generate a 500ms impulse when the alarm goes ON.  |
| PULSE-S  | Output generate a 100ms impulse when the alarm goes ON.  |

| NOTE n.8 |   |
|----------|---|
| PULSE    | Enables exit function as impulsive          |
| ALARM    | Enables exit function as alarm              |
| REMOTE   | Enables function output via protocol Modbus |
| NO       | Normally open                               |
| NC       | Normally closed                             |


| NOTE n.9 |  |
|----------|--|
| P-IMP    | Imported Active Power (Energy)                     |
| QL-IMP   | Imported Reactive Inductive Power (Energy)         |
| QC-IMP   | QC-IMP Imported Reactive Capacitive Power (Energy) |
| S-IMP    | Imported Apparent Power (Energy)                   |
| P-EXP    | Exported Active Power (Energy)                     |
| QL-EXP   | Exported Reactive Inductive Power (Energy)         |
| QC-EXP   | Exported Reactive Capacitive Power (Energy)        |
| S-EXP    | Exported Apparent Power (Energy)                   |

| NOTE n.10 |                          |
|-----------|--------------------------|
| YES       | Referred to CT primary   |
| NO        | Referred to CT secondary |

| NOTE n.11 |  |
|-----------|--|
| ALLARME 1 | Alarm related to the physical output: DIGITAL OUT 1 (DO1, terminal 11) |
| ALLARME 2 | Alarm related to the physical output: DIGITAL OUT 2 (DO2, terminal 12) |
| ALLARME 3 | Only MODBUS alarm  |
| ALLARME 4 | Only MODBUS alarm  |

## MESSAGE “CFG ERROR”


During the set up operation a “CFG ERROR” message could appear. This means that some wrong parameters are typed. To restore the factory default settings use the following procedure (RESTORE FACTORY SETTING):

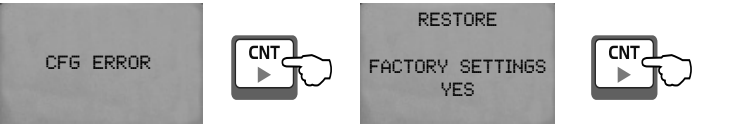

Once this procedure is done the meter is configured with its factory default settings. Stored data will remain after the restore operation.

## INPUT & OUTPUT CONNECTION

(only for version PFAE611-12)

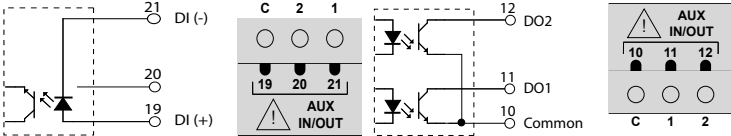


| Digital Inputs             |                   |
|----------------------------|-------------------|
| Supply voltage (external): | from 10 to 30 Vdc |
| Current consumption:       | from 2 to 10mA    |
| Max. count frequency       | 10 or 100Hz       |

N.B. For gas meters a galvanic separation is needed per ATEX standards


| Digital outputs (optocoupled NPN transistor type for DIN 43864) |        |
|---|--------|
| Maximum applicable voltage:                                     | 27 Vdc |
| Maximum switchable current:                                     | 27 mA  |

## INPUT & OUTPUT CONNECTION EXAMPLE

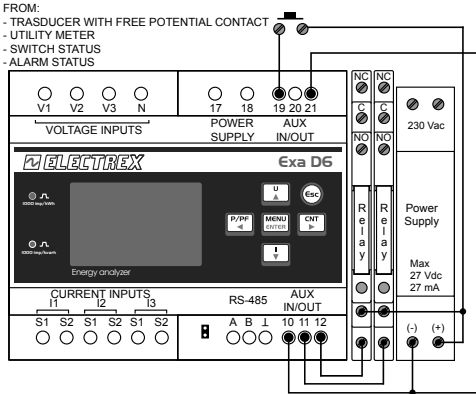

**LED**

### Description of the LEDs

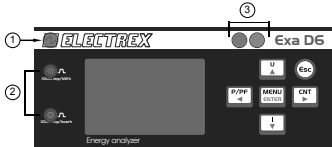

|         |  |
|---------|--|
| LED (1) | Under the sine wave symbol next to the Electrex logo a red LED indicates the operation status                            |
| LED (2) | Two red LEDs, for calibration checking, pulse with a frequency proportional to the active and reactive energy imported.  |
| LED (3) | Two other LEDs, below the white band, indicate the communication activities of the RS485 port (red LED TX, green LED RX) |

## ALARM SET UP EXAMPLE

To ensure that the exit "DIGITAL OUT 1" remain excited for the alarm duration (latching) when average active power (MEAS 344) exceeds the value of 100 kW, hysteresis, 5% and latency of 5 seconds set the parameters such as table:

|                      |                          |  |        |
|----------------------|--------------------------|--|--------|
| <b>ALARM 1 / A</b>   | MODE ( <i>note n.2</i> ) | Normal, 1-OF-3, 3-OF-3, DERIV, UNBAL                     | NORMAL |
|                      | TYPE ( <i>note n.3</i> ) | MAX, MIN   | MAX    |
|                      | MEAS ( <i>note n.4</i> ) | Controlled measure. See table n.1 for register selection | 344    |
|                      | THRE ( <i>note n.4</i> ) | Threshold value  | 100000 |
| <b>ALARM 1 / B</b>   | HYST                     | 1...100 (%)  | 5      |
|                      | DELAY                    | 1...99 (seconds)   | 5      |
|                      | AVG ( <i>note n.5</i> )  | 1...99 (seconds)   | 1      |
|                      | OUT ( <i>note n.6</i> )  | Normal, Hold, Pulse-L, Pulse-S                           | NORMAL |
| <b>DIGITAL OUT 1</b> | MODE                     | PULSE, ALARM, REMOTE                                     | ALARM  |
|                      | POLARITY                 | NO, NC   | NO     |

To ensure that the exit "DIGITAL OUT 2" remain excited for the alarm duration (latching) when average active power (MEAS 344) goes down the value of 90 kW, hysteresis, 5% and latency of 5 seconds set the parameters such as table:

|                      |                          |  |        |
|----------------------|--------------------------|--|--------|
| <b>ALARM 2 / A</b>   | MODE ( <i>note n.2</i> ) | Normal, 1-OF-3, 3-OF-3, DERIV, UNBAL                     | NORMAL |
|                      | TYPE ( <i>note n.3</i> ) | MAX, MIN   | MIN    |
|                      | MEAS ( <i>note n.4</i> ) | Controlled measure. See table n.1 for register selection | 344    |
|                      | THRE ( <i>note n.4</i> ) | Threshold value  | 90000  |
| <b>ALARM 2 / B</b>   | HYST                     | 1...100 (%)  | 5      |
|                      | DELAY                    | 1...99 (seconds)   | 5      |
|                      | AVG ( <i>note n.5</i> )  | 1...99 (seconds)   | 1      |
|                      | OUT ( <i>note n.6</i> )  | Normal, Hold, Pulse-L, Pulse-S                           | NORMAL |
| <b>DIGITAL OUT 2</b> | MODE                     | PULSE, ALARM, REMOTE                                     | ALARM  |
|                      | POLARITY                 | NO, NC   | NO     |

## VOLTAGE AND CURRENT CONNECTION


**Voltage connection:** Use cables with max cross-section of 2,5 mm<sup>2</sup> if stranded 4 mm<sup>2</sup> if rigid and connect them to the clamps marked VOLTAGE INPUT on the instrument according to the applicable diagrams that follow.

**Current connection:** It is necessary to use external CTs with a primary rating adequate to the load to be measured and with a 5A or 1A secondary rating. Connect the CT output(s) to the terminals marked I1, I2, I3 (CURRENT INPUT) of the instrument according to the applicable diagrams that follow. Use cables with cross-section adequate to the VA rating of the CT and to the distance to be covered. The max cross-section for the terminals is 2,5 mm<sup>2</sup> if stranded and 4 mm<sup>2</sup> if rigid.


**N.B.** The CT secondary must always be in short circuit when not connected to the instrument in order to avoid damages and risks for the operator.

Scrupulously respect the matching of phase between the voltage signals and current signals (RTD) and the direction of insertion of CT (P1-P2 and S1-S2). Failure to comply with this correspondence and connection diagrams gives rise to measurement errors. (\*) The grounding of S2 must be close to the CT and not near the instrument.


### STAR 4W (4 WIRES) 3PH-4W LV

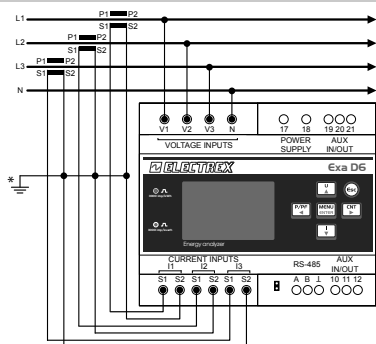


### STAR 4W (4 WIRES) 3PH-4W MV

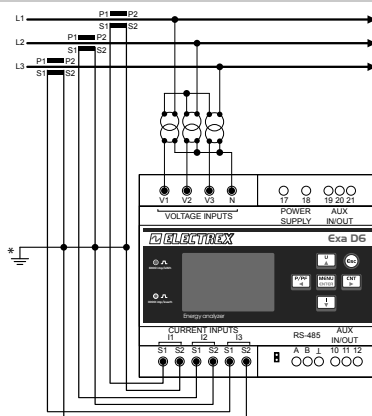


### STAR 4W (4 WIRES) 3PH-4W-BAL

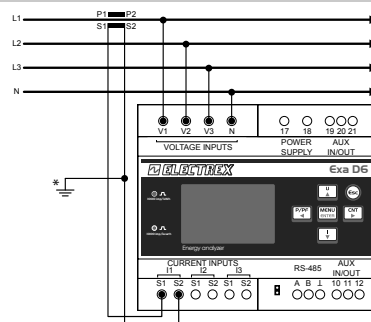


### TRIANGLE 3W (3 WIRES) 3PH-3W

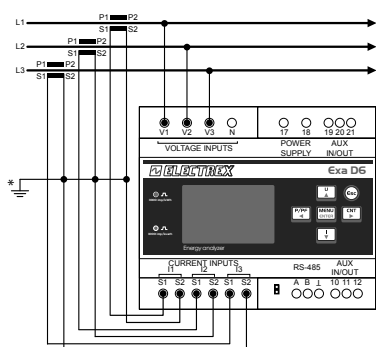


### TRIANGLE 2CT (3 WIRES) 3PH-3W

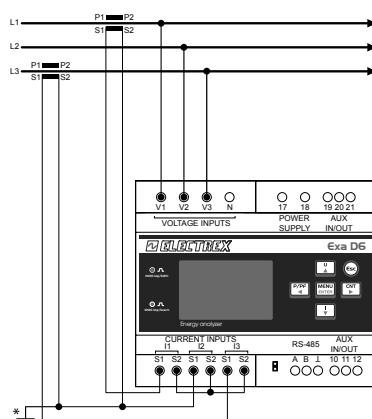


### MONOPHASE (2 WIRES) 1PH-2W

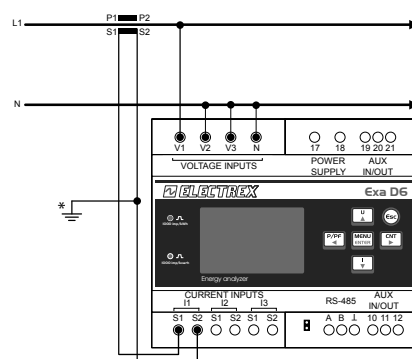


### TRIANGLE 2CT(3 WIRES) 3PH-3W

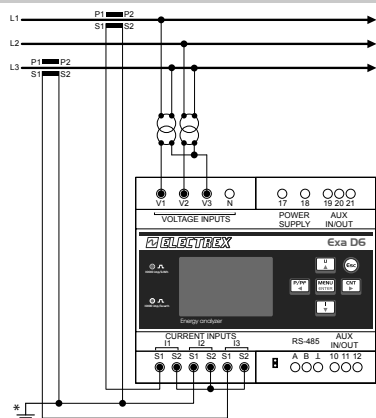


### TRIANGLE 2CT (3 WIRES) 3PH-3W

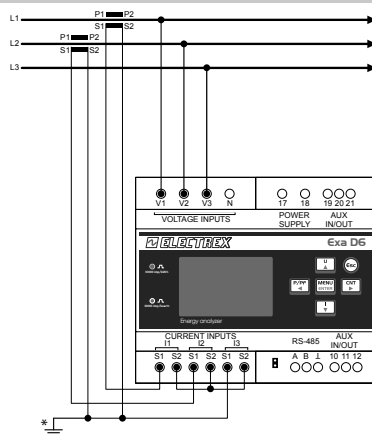

### TRIANGLE 2CT (3 WIRES) 3PH-3W

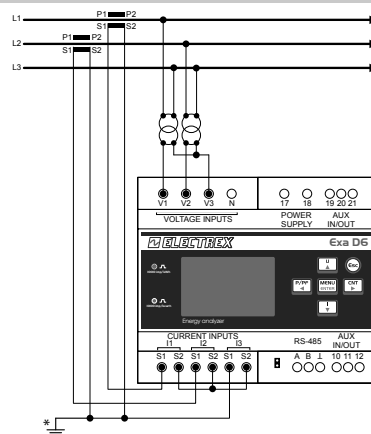

### BI-PHASE (2 WIRES) 2PH-2W

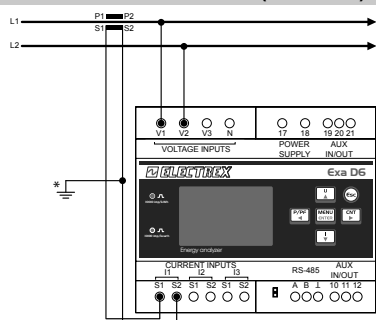

### POWER SUPPLY AND SERIAL LINE CONNECTION

The instrument is fitted with a separate power supply. The power supply terminals are numbered (17 e 18). Use cables with max cross-section of 2,5 mm<sup>2</sup> if stranded, 4 mm<sup>2</sup> if rigid.

